

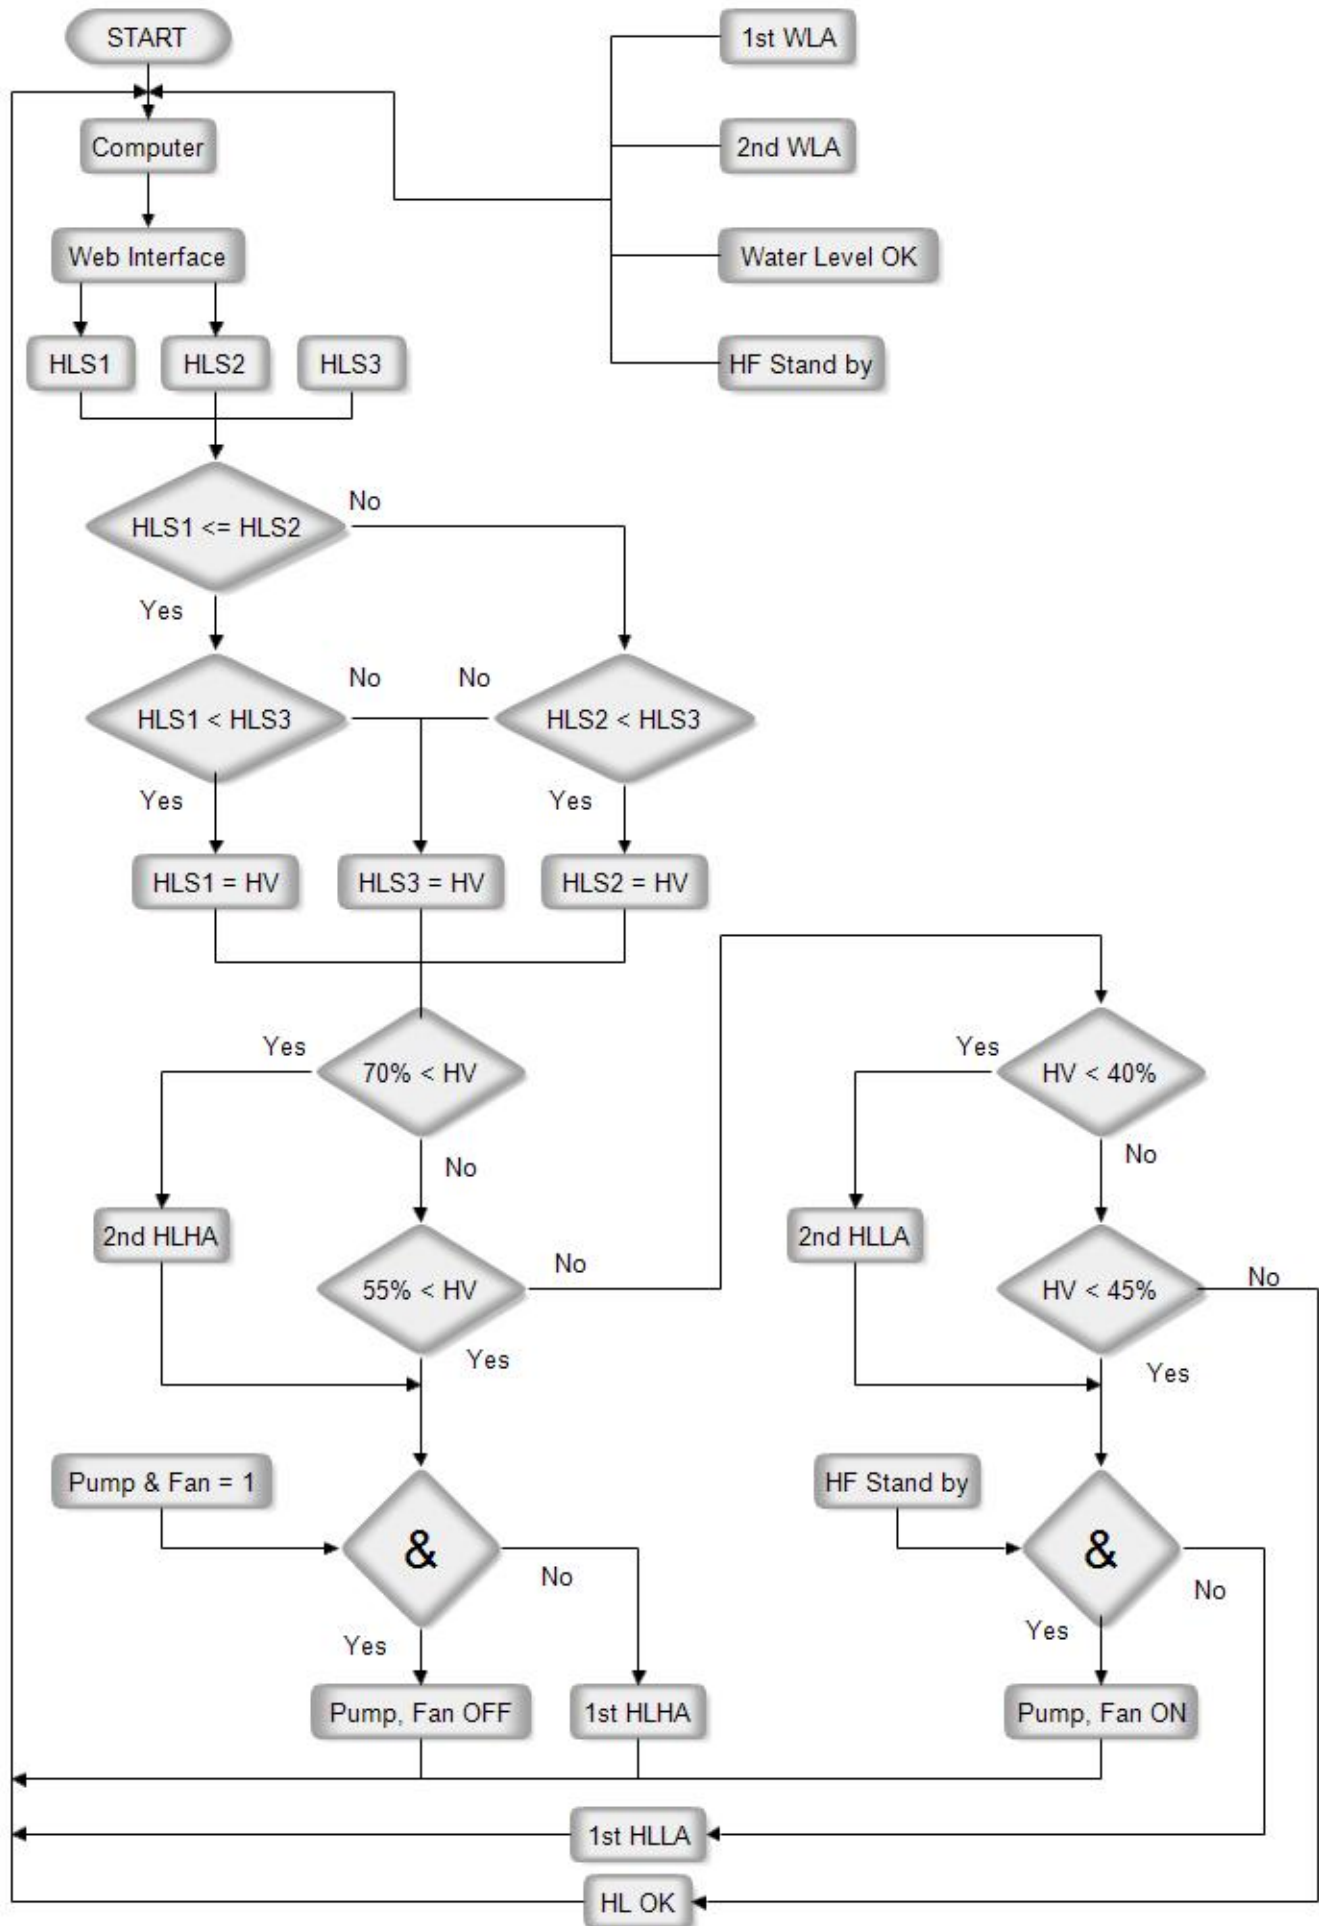
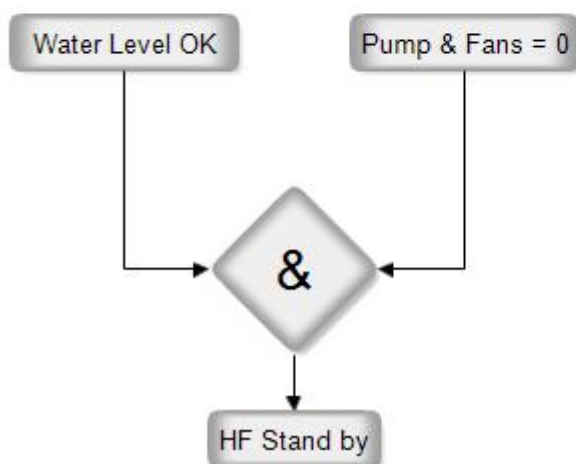


CONTROL DIAGRAM

Humidifier system control

- HV: Humidity Value
- HLS 1,2,3 : Humidity Level Sensor
- HF Stand by: Humidifier Stand by
- WLS 1,2 : Water Level Sensor
- 1st WLA: 1st Water Level Alarm
- 2nd WLA: 2nd Water Level Alarm
- HL OK: Humidity Level is OK
- 1st HLLA: 1st Humidity Level LOW Alarm (Humidity level is under 45%)
- 2nd HLLA: 2nd Humidity Level LOW Alarm (Humidity level is under 40%)
- 1st HLHA: 1st Humidity Level HIGH Alarm (Humidity Level is above 55%)
- 2nd HLHA: 2nd Humidity Level HIGH Alarm (Humidity Level is above 70%)

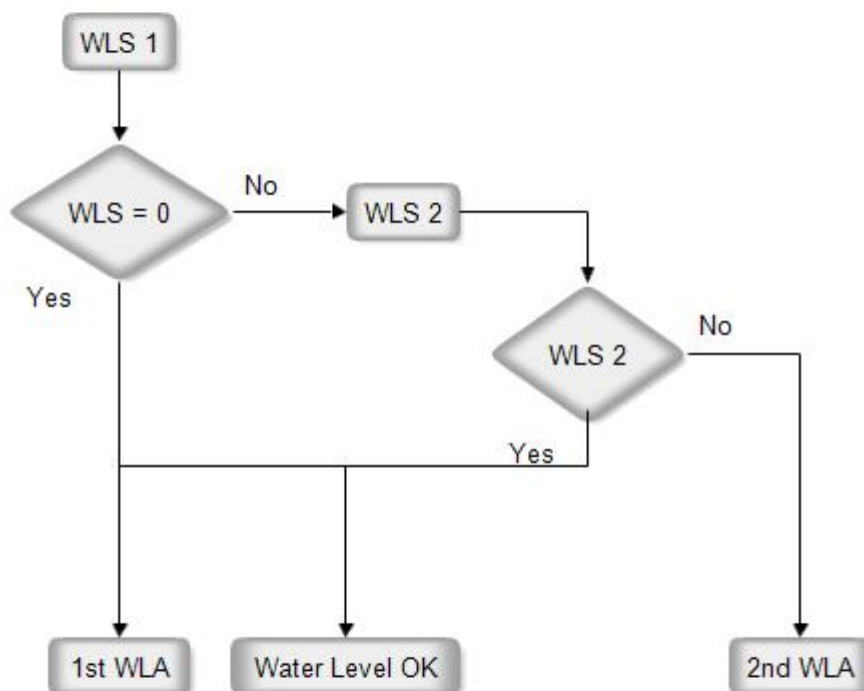

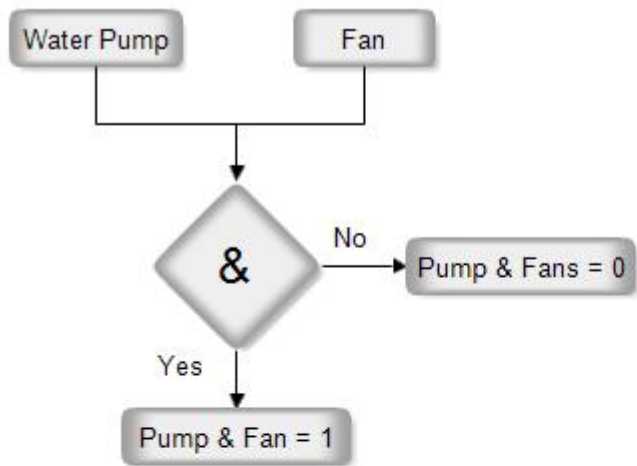

From:

<https://www.eps2011-wiki1.dee.isep.ipp.pt/> - **EPS@ISEP G1**

Permanent link:

<https://www.eps2011-wiki1.dee.isep.ipp.pt/doku.php?id=flowcharts>

Last update: **2011/05/31 20:28**

